

DISTRIBUTION SYSTEM MANAGEMENT

Biofilms

Understanding and Controlling Biofilms


Quick Facts

- Organic and inorganic materials form biofilms on the inside of pipes and storage tanks.
- Biofilms are ubiquitous in all distribution systems.
- Diverse microbial communities colonize biofilms.

Overview

Biofilms are accumulations of microorganisms (e.g., bacteria, fungi, algae, protozoa, and viruses) and organic and inorganic matter bound by extracellular polymer substances attached to the inner surfaces of pipes and storage tanks in water systems. Biofilms are ubiquitous in all distribution systems, regardless of water quality characteristics and pipe materials (Figure 1), and provide an environment for bacterial replication as well as protection against disinfectants and microbial predators.

Pathogens can enter water systems through treatment breakthrough, inadvertent contamination of a distribution system (e.g., main breaks, breaches in storage tanks), or deliberate contamination. If any of these occur, introduced pathogens may interact with the surfaces of the distribution system and can become entrained in biofilms. Thus, biofilms can become central to the microbial ecology of opportunistic pathogens

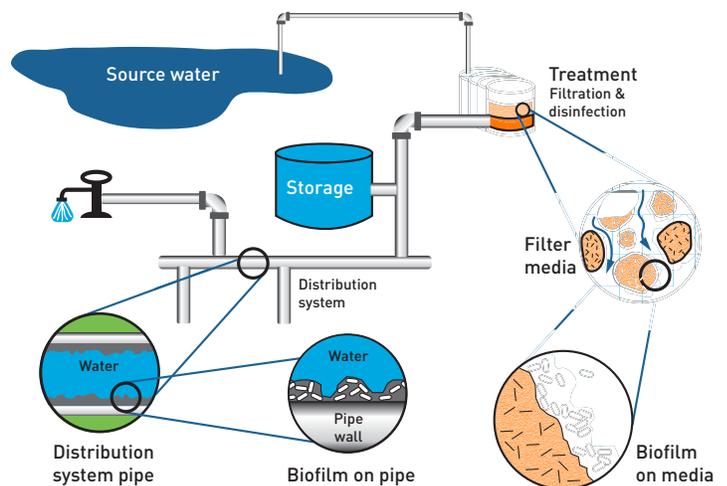

Source: MSU, Center for Biofilm Engineering 1999

Figure 1. Diagram of a water distribution system showing locations for biofilm growth

(infectious microorganisms that are capable of causing disease in certain risk groups) in distribution systems and premise plumbing.

Studies have shown that biofilms in drinking water systems can serve as reservoirs for *Helicobacter pylori* (bacteria that can cause ulcers and cancer), *Legionellae* species (bacteria that can lead to legionellosis) and *Mycobacterium avium* (which can cause lung infections) (Watson et al. 2004, Mackay et al. 1998, Rogers and Keevil 1992, Lehtola et al. 2007). Free-living protozoa can be part of biofilm ecosystems and are increasingly recognized for harboring pathogens. Biofilms are also possible contributors to coliform regrowth. Detection of coliform bacteria in a distribution system is an indication of possible fecal contamination, which can lead to potential risks from all waterborne pathogens.

While biofilms can be a source of concern for water utilities, in drinking water distribution systems they have been associated with the removal of some haloacetic acids (HAAs) including mono-halogenated compounds and di-halogenated species (but not tri-halogenated species) (Bayless and Andrews 2008). The dominant HAA degraders in drinking water system enrichment cultures are *Afiplia* spp. (Hozalski et al. 2010).

Biofilms and Other Water Quality Concerns

Corrosion

Biofilm growth can increase localized cast iron pipe corrosion by changing oxygen concentration and electrical potential of the pipe wall (Lee et al. 1980). While biofilm growth in a water pipe can be beneficial as a barrier to corrosion, it is generally considered to be detrimental in most aspects of iron corrosion (McNeill and Edwards 2001). Additionally, anaerobic sulfate-reducing bacteria can contribute to micro-biologically induced corrosion by generating hydrogen sulfide gas that accelerates corrosion processes (Beech 2003).

Nitrification

Nitrification is a biological process by which ammonia is sequentially oxidized to nitrite and nitrate. Ammonia-oxidizing bacteria (AOB) are ubiquitous in chloraminated distribution systems, and biofilms can help AOB survive disinfectant residuals. AOB growth

in biofilms is much greater than in the bulk water and is implicated in the onset of nitrification events.


Taste and Odor

Some microbes, such as actinomycetes and iron and sulfur bacteria, are common in pipe biofilm. These may detach into the water and proliferate in the system, frequently leading to taste, color, and odor problems in drinking water.

Biofilm Control

Biofilms are heterogeneous, inherently patchy, and colonized with diverse microbial communities—qualities that make biofilm control challenging for water utilities.


There are several biofilm mitigation strategies, such as flushing, swabbing/pigging, chemical treatments, and ice pigging. Flushing is the most popular method, but it is not always effective. It is suited to water mains fewer than 12" in diameter and may not work well on some deposits,

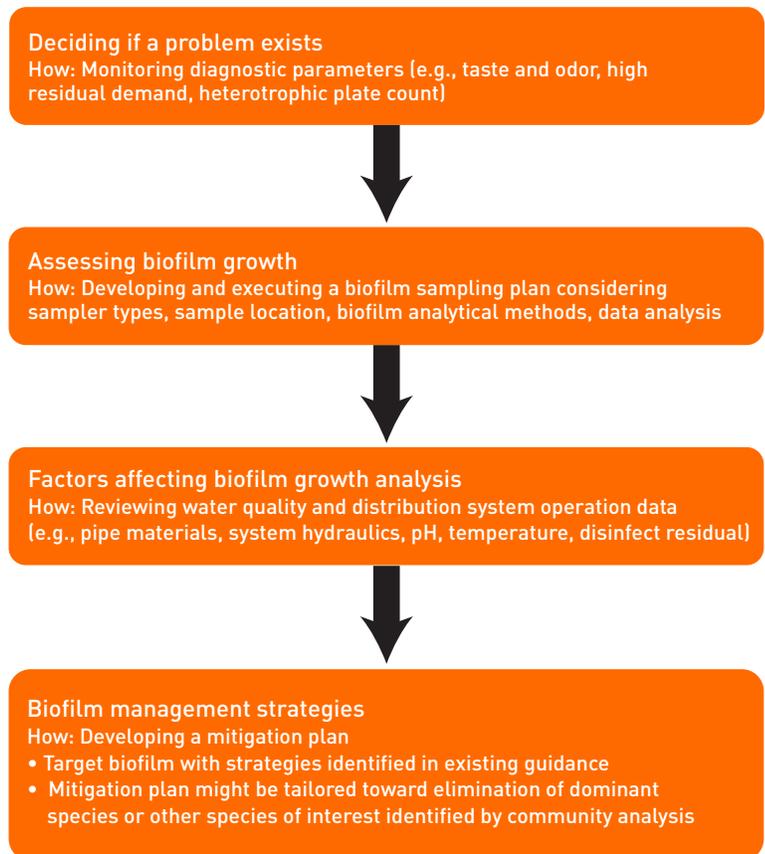

Source: Hausner et al. 2012

Figure 2. Diagram of biofilm assessment and management steps



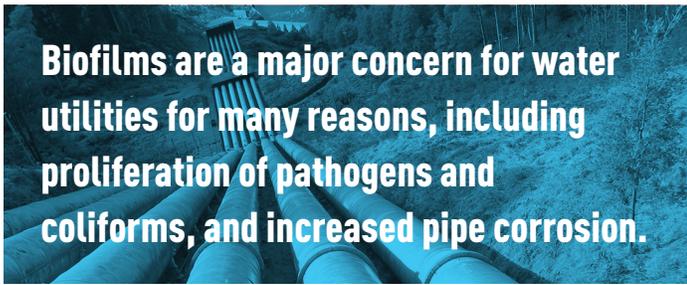

such as manganese coatings or adherent corrosion scale. Figure 2 shows the four steps for biofilm assessment and management decision-making (Hausner et al. 2012). 

References

- Bayless, W., and R. C. Andrews. 2008. "Biodegradation of Six Haloacetic Acids in Drinking Water." *J. Water Health*, 16(1): 15–22.
- Beech, I. B. 2003. "Sulfate-Reducing Bacteria in Biofilms on Metallic Materials and Corrosion." *Microbiol. Today*, 30: 115–117.
- Hausner, M., A. Packman, and S. Waller. 2012. *Assessing Biofilms in Distribution Systems*. Project #4087. Denver, Colo.: Water Research Foundation.
- Hozalski, R., P. Zhang, T. LaPara, A. Grigorescu, L. Leach, A. Camper, E. Goslan, S. Parsons, and Y. Xie. 2010. *Biodegradation of HAAs in Distribution Systems*. Project #3122. Denver, Colo.: Water Research Foundation.
- Lee, S., J. O'Connor, and S. Banerji. 1980. "Biologically Mediated Corrosion and its Effects on Water Quality in Distribution Systems." *Jour. AWWA*, 72(11): 636–645.
- Lehtola, M., E. Torvinen, J. Kusnetsov, T. Pitkänen, L. Maunula, C. von Bonsdorff, P. Martikainen, S. Wilks, W. Keevil, and I. Miettinen. 2007. "Survival of *Mycobacterium avium*, *Legionella pneumophila*, *Escherichia coli*, and Caliciviruses in Drinking Water-Associated Biofilms Grown under High-Shear Turbulent Flow." *Appl. Environ. Microbiol.*, 73(9): 2854–2859.
- Mackay, W., L. Gribbon, M. Barer, and D. Reid. 1998. "Biofilms in Drinking Water Systems: A Possible Reservoir for *Helicobacter pylori*." *J. Appl. Microbiol.*, 85(December 1998): 52S–59S.
- McNeill, L., and M. Edwards. 2001. "Iron Pipe Corrosion in Distribution Systems." *Jour. AWWA*, 93(7): 88–100.
- MSU (Montana State University), Center for Biofilm Engineering. 1999. "CBE Image Library." Water Distribution System. Bozeman, Mont.: Montana State University. Accessed August 26, 2014. <http://www.biofilm.montana.edu/multimedia/images/download.html?id=1076>.
- Rogers, J., and C. Keevil. 1992. "Immunogold and Fluorescein Immunolabelling of *Legionella pneumophila* within an Aquatic Biofilm Visualized by Using Episcopic Differential Interference Contrast Microscopy." *Appl. Environ. Microbiol.*, 58(7):2326–2330.
- Watson, C., R. Owen, B. Said, S. Lai, J. Lee, S. Surman-Lee, and G. Nichols. 2004. "Detection of *Helicobacter pylori* by PCR but not Culture in Water and Biofilm Samples from Drinking Water Distribution Systems in England." *J. Appl. Microbiol.*, 97(4): 690–698.

Last updated July 2017